


Sales Office
20675 N. Friends Road
P. O. Box 309
Greenleaf, ID 83626
USA



www.SOLAR GAUGE™.com
by
**GREENLEAF
GAUGE**
A Division of I.T.M. Electronics, Inc.



888-884-2843
888-884-4145 - Fax
Outside USA
208-453-1714
208-459-3365 - Fax

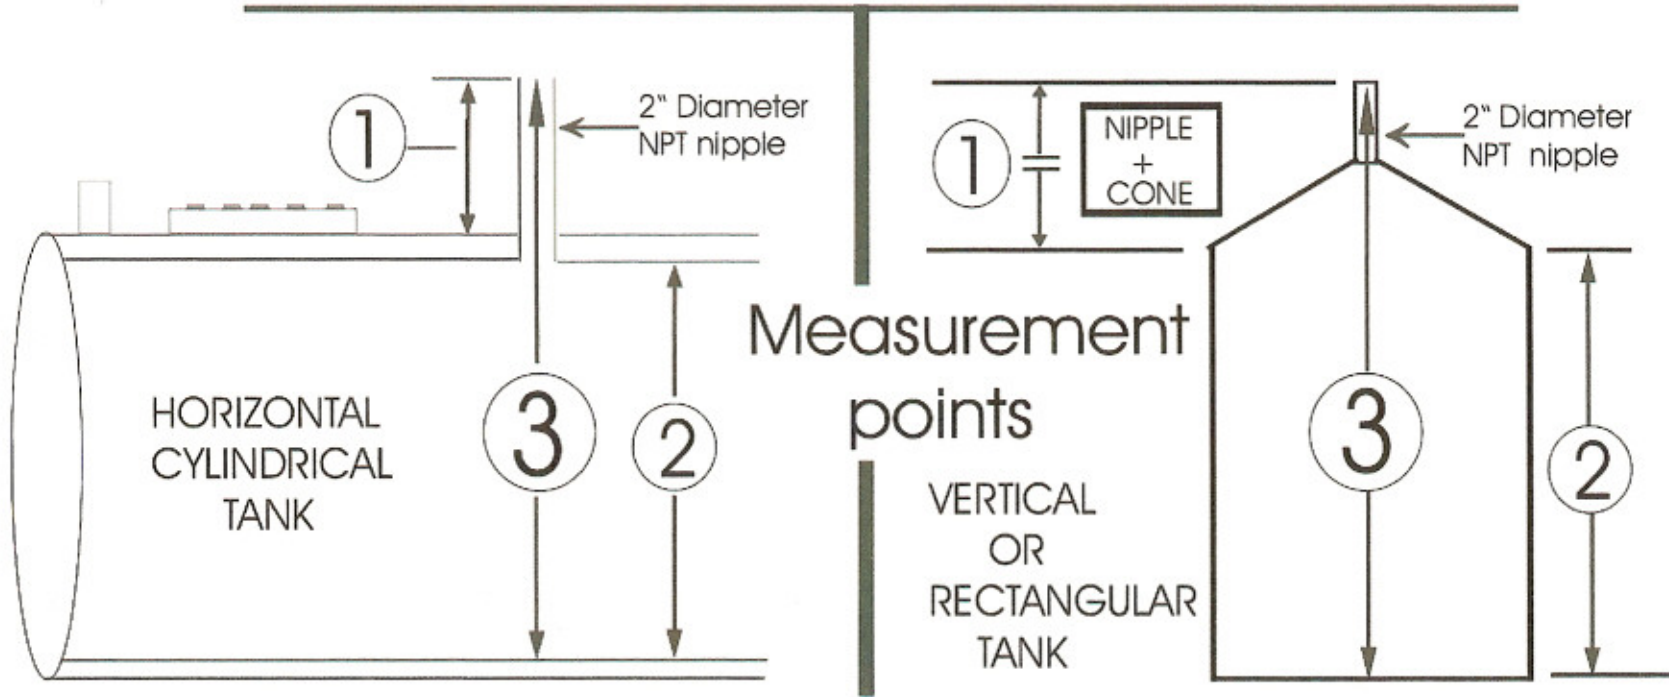

YOUR TANK MEASUREMENTS ARE CRITICAL TO THE ACCURACY OF OUR GAUGES.

1. Top of the 2" NPT pipe nipple must be at least 6" above the top of the primary tank or 6" above top of the straight walls on vertical tanks. With cone top tanks, this 6" requirement can be accomplished by adding the nipple height to the height of the cone top. (See # 1)
2. Height of primary tank. On tanks with cone tops, measure to the top of the straight walls. (See #2) Standard units cannot measure the liquid that goes up past the straight walls into the cone top.
3. Simply measure down through the 2" nipple to the bottom of the tank. Record the distance from the bottom of the tank to the top of the installed nipple. (See #3) ***THIS MEASUREMENT IS CRITICAL FOR PROPER GAUGE OPERATION.***

ORDER FORM ON BACK