




EFG-8000 User's Guide

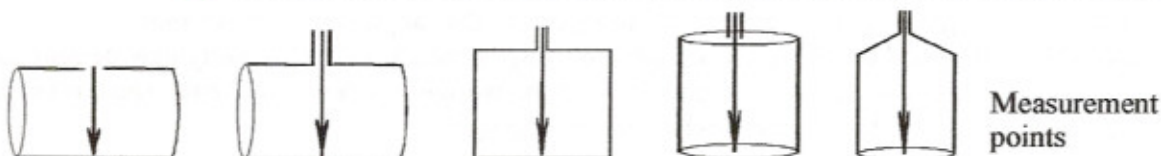

You **MUST**:

- accurately measure the tank from the top of the 2" pipe nipple to the bottom of the tank. Refer to drawings below.
- verify the **actual** tank capacity. Using the incorrect tank capacity will produce incorrect results. Refer to formulas on page 7 to compute tank capacities.
- ensure that the 2" NPT pipe nipple is vertically straight using a level. Adjust if needed.



Measurement points

DO NOT PROCEED WITHOUT UNDERSTANDING THE FOLLOWING:

1. The unit has been put into a "**SLEEP MODE**" for storage and shipping to preserve power. Sleep mode will display the Program Version Only. Touch the PLANET symbol  on the front of the gauge with the red pocket magnet calibration tool to take out of the sleep mode and prepare for normal operation. Hold the magnet on the PLANET symbol  only long enough for the display to change. The gauge will display Ξ - - - - then go to normal operating mode. Programming mode is entered by holding magnet on planet long enough for - - - - to appear.
2. The probe, transducer, and gauge are a matched set. If for any reason they are separated or used in an application other than that which they were intended, re-programming will be required.



PROBE



TRANSDUCER



GAUGE

This order # _____ Type of liquid _____ Tank capacity _____

The probe for this tank was ordered and custom designed for use in a tank that measures inches from the top of the 2" pipe nipple to the bottom of the primary tank. If the actual distance differs from this amount, you will need to compensate by changing the length of the bead chain used to connect the probe to the transducer. Extra chain and a splicing link have been provided if you need to add chain. The chain can be shortened by cutting it to the desired length, or an additional riser can be installed.

THE PROBE MUST NEVER TOUCH THE BOTTOM OF THE TANK DURING NORMAL OPERATION or EXTEND ABOVE THE PRIMARY TANK HEIGHT. SEE ORDER INFORMATION SHEET FOR PLACEMENT. REFER TO PAGE 7 FOR TROUBLESHOOTING AND TECHNICAL ASSISTANCE.



EFG-8000

USER'S GUIDE

THIS INFORMATION PACKET INCLUDES THE FOLLOWING INFORMATION

GAUGE CALIBRATION INSTRUCTIONS: The SOLAR GAUGE™ is a unique product.

The calibration is much like programming a digital watch. Please follow these instructions closely. You will be asked to determine and confirm the shape of the tank and the actual tank capacity. Your gauge has been calibrated at the manufacturer. Programming the gauge is easily accomplished in the field. An "off set" option is available which can either add to, or subtract from the liquid value of the tank, depending on your specific calibration needs. (Refer to calibration instructions)

WARRANTY: A detailed copy of the terms and conditions of product application and warranty.

REPAIR AND RETURN POLICY: We service what we sell. Products under warranty may be sent back to Greenleaf Gauge for replacement or repair. Products past the warranty period may be returned to Greenleaf Gauge for repair or a core refund toward the purchase of a new gauge.

GENERAL PRODUCT INFORMATION

OPERATION:

The probe that is used with this gauge has been custom designed according to your specifications. These include: 1. Type of liquid to be measured. 2. Height of tank. 3. Capacity of tank 4. An accurate measurement from the top of the pipe nipple that the transducer is to be installed on, to the bottom of the tank. Use of this probe on a tank other than the one it was custom designed for, or in a product other than the one it was designed for, may provide inaccurate results. When properly installed, the probe must never contact the bottom of the tank, rest against the side of the drop tube (if used), or be allowed to touch any internal structures.

POWER:

The EFG-8000 can be powered by either a solar cell, or two (2) non-rechargeable 9 volt batteries. The solar cell model is intended for outdoor use. If you have an indoor location where you wish to use the gauge, or an outdoor location with inadequate light, please contact your distributor or Greenleaf Gauge today about our model which operates by the power of two (2) non-rechargeable 9 volt batteries

MEASUREMENTS:

The EFG-8000 will display up to five digits to show measurable units in gallons, liters, pounds, inches or % full. The same five digit display is used during setup, calibration, and to display operation or error messages.

INSTALLATION:

The EFG-8000 must be installed in accordance with your local regulations and manufacturer's specifications. Failure to do so may affect the long term service of the gauge and may void the warranty. Any regulatory issues should be directed to your local entity having jurisdiction over the issues involved. *Manufacturer's specifications require any wire connections to the transducer, gauge, and their connectors, to be protected from the elements and other possible physical damages, by the use of appropriate electrical items such as conduit and junction boxes. The manufacturer will not be responsible for problems arising from improper equipment installation which may also void the warranty. Please refer to assembly instructions, page 3.*

IMPORTANT NOTICE: When this gauge and alarm are utilized as the High-level warning, the test/reset button should ALWAYS be tested by the operator before tank filling. If it does not respond correctly DO NOT FILL. The operator must monitor the tank filling process and the status of the gauge and alarm to prevent overfills.

HELP: For technical help please contact us between 9-5 M-F MST : Local 208-453-1714, or toll free 888-88-GAUGE (888-884-2843). Our fax numbers are 208 459-3365, or 888-884-4145, or visit us online at www.solargauge.com.

ASSEMBLY / INSTALLATION INSTRUCTIONS

Please remember that even though the probe is well made, the material is very thin walled and needs to be handled with care at all times.

NOTICE TO TANK MANUFACTURERS AND DISTRIBUTORS!

We recommend the gauge and probe be installed at the final destination. If it is necessary to install the gauge and probe before shipping to the final destination, the probe may be allowed to swing freely in the tank but precautions must be taken to eliminate it from "hanging up" on any internal tank structures. The probe must not be allowed to rub on anything in the tank during normal operation or it will severely reduce the accuracy of the gauge.

TO ASSEMBLE "ONE SECTION" PROBE

1. Remove the probe, gauge, and transducer from the shipping boxes. Take care to remove all packing materials (bubble wrap, tape, etc.) from the units. You may use a clamp near the top of the probe during installation. This clamp will keep the probe from falling into the tank during assembly.

2. Insert the probe (See Figure 1) down into the 2" pipe nipple. Apply a good quality pipe thread sealant to the 2" pipe threads. Connect the probe to the transducer assembly. **For multi-section probes see instructions below.**

3. To connect the probe to the transducer, simply snap the free end of the chain on the top of the probe into the end coupling connected to the split ring located at the bottom of the transducer. (See Figure 2) Screw the transducer assembly onto the tank's 2" pipe nipple. **When the tank is empty the probe should never touch the bottom of the tank. Adjust the bead chain so that the bottom of the probe is the distance from the tank bottom as specified on the order information sheet.**

4. Mount the gauge (See Figure 3) to the tank at the location of your choice. Connect the transducer assembly to the gauge by use of the wire and wire nuts provided. **CONNECT LIKE COLORED WIRES TOGETHER.** Remove right cover plate from gauge console. Carefully unplug the alarm wire from the connector board inside. Set cover and screws aside while wiring the console. Attach necessary conduit fittings to the gauge to weather proof the console before inserting wire from the transducer through the conduit into the gauge console. Connect wires to wire terminal according to wiring label inside the gauge console. Plug alarm wire back into the connector board. Carefully position the cover plate back onto the gauge console to ensure weather proof seal and replace ALL screws. To comply with manufacturer's specifications, wire and wire connectors must be installed using appropriate junction boxes and conduit to protect it from the weather or other damages.

NOTE: Water destroys live electronics. Precautions must be taken to eliminate water from getting into the gauge console. Manufacturer's recommendation is to install a conduit junction with a drain at a lower elevation than the gauge and / or conduit seal at the gauge to eliminate moisture from entering the console. We recommend using a sealant to plug the hole that the wires pass through to enter the gauge. (See Figure 4) Failure to do so may void the warranty.

This gauge has been calibrated at the manufacturer to your specifications. Please refer to the gauge and probe packing slips for details. If your gauge or the probe specifications do not match your tank dimensions and requirements, you will need to purchase a different probe. If you need to calibrate the gauge, this can be easily accomplished by following the instructions page titled CALIBRATION.

TO ASSEMBLE "MULTI-SECTION" PROBES

Remove the probe sections from the shipping container and the packing materials. Please use only the cotter pins provided to connect the sections of the multi-section probe, as all components are carefully weighed. (See Figure 5) Lower the probe into the tank beginning with the bottom section. Carefully slide the sections together over the joining plug and align the matching colored arrows then insert cotter pins. Repeat procedure until all sections are connected and lowered into the tank. Connect the fully assembled probe to the transducer. Continue installation with steps 3 and 4 in "TO ASSEMBLE ONE SECTION PROBE" instructions.

HELP: For more detailed technical support please call us between 9-5 M-F MST : Local 208-453-1714, or call our toll free number at **888-884-2843**, or visit our web site online at www.solargauge.com.




Figure 1




Figure 2



Figure 3

Preferred Entry



Alternate entry



Figure 4

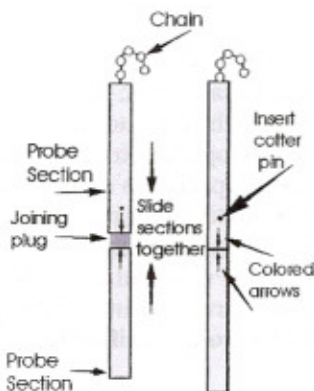


Figure 5


PROGRAMMING INFORMATION

Included with the **SOLAR GAUGE** is a 6" pocket magnet. This is the tool used in the calibration of the gauge. On the face of the gauge, you will find three symbols which are also important to the calibration process. These three symbols are:




PLEASE READ ALL INSTRUCTIONS BEFORE PROGRAMMING THE GAUGE.

Prior to calibration, determine what shape of tank the gauge will be used on. See diagrams below:

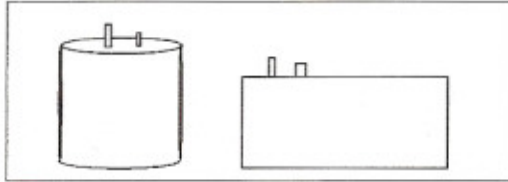

STRAIGHT TANKS

OR

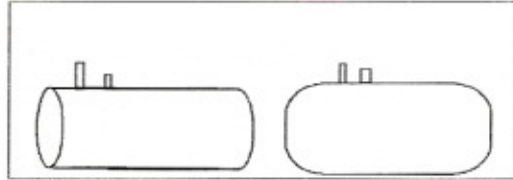

ROUND TANKS, & CUSTOM SHAPES

SYMBOLS USED DURING PROGRAMMING:

Displayed during setup and programming.

- | | |
|-----------------------------------|--------------------------------------|
| --- Tank select mode | -HP- High calibration point |
| -00- Round tank program or | -RL- Alarm - low level |
| -11- Straight tank program | -RH- Alarm - high level |
| -PP- Program tank capacity | -05- Off set value (optional) |
| -LP- Low calibration point | END- Programming complete |

SYMBOLS USED DURING OPERATING MODE:

HELP Gauge will alternate the **HELP** error message code with one of the following error codes to help identify the problem area to correct. **DO NOT FILL TANK** until problem has been corrected and the gauge is operating properly.

- | | |
|---|---|
| -*** Negative number- the gauge has gone below the determined zero level. | 0-0 Connection failure between the transducer and gauge. |
| EEEE Measurement has exceeded the set capacity of the tank, or probe is resting on bottom of the tank. | -EE- Reading has gone below extended range. |
| | ISLR Interstitial leak alarm (optional model) |
| | LOBR Low battery. Contact distributor for replacement. |

(*) Represents any numerical value, 0 through 9

BATTERY

The EFG-8000 is equipped with a replaceable backup battery. Should the error code, **LOBR**, appear for low battery, contact your distributor or Greenleaf Gauge for an authorized battery replacement. Use of an improper battery may damage the gauge, or effect the operation of the gauge and alarm.

HIGH / LOW ALARM

The EFG-8000 model with Alarm features a **High Level Alarm** which can be set from 95% to the Low level Alarm % of tank capacity (as per instructions in calibration section of this user's guide). The High Level Alarm can not be disabled. The alarm will enunciate every 0:03 sec for 0:90 sec, after which it will enunciate every 0:06 sec until the operator presses and holds the reset button for 0:30 sec. To conserve the power supply, we highly recommend that the operator turn off the alarm as soon as it sounds a high level warning. The **Low Level Alarm** can be set at any % of tank capacity up to the high level setting and will enunciate with a less frequent (every 0:20 or 0:90 sec) series of three "chirps" until liquid is added to the tank. To disarm the low level warning alarm the operator can set the values to **00** (as per calibration instructions).

WARNING: The individual filling the tank should always test the alarm prior to filling the tank. Press and hold the "Test / Reset" button until three short beeps are heard, indicating that the gauge and the alarm are working properly. This does not, however, insure that the tank and alarm settings were properly entered. This has to be verified in the programming mode above at the time of installation.

CALIBRATION INFORMATION



Typically, all gauges come with all the calibrations already entered. These next two pages are for your information on how to program the gauge if adjustments are needed.

DO NOT ADJUST THE -HP- VALUE UNLESS YOU HAVE CONTACTED GREENLEAF GAUGE AND CONFIRMED THE NEW VALUE ENTERED

Before proceeding with calibration instructions, please read and understand the following information.

As noted all gauges should have been calibrated by the manufacturer to your tank specifications. Refer to gauge order information provided with the gauge. In all other cases you must physically measure or have the tank manufactures dimensions of the tank. From this information we can confirm the total capacity of the tank and the volume per inch of the liquid inside. With this information we can compare to the gauge read out. If the difference is greater than 2% of the total capacity, it maybe necessary to re-calibrate, follow these instructions carefully. As mentioned, the transducer is matched to the gauge, in the event that a different transducer is connected to the gauge, the new transducer HC and LC numbers **MUST BE CHANGED**. If this is not done, the gauge may seem to operate but will **NOT TRACK** the actual volume correctly. **NOTE:** If you feel you need any assistance in changing the calibration values, please feel free to call Greenleaf Gauge at 888-884-2843 between 9:00-5:00 M-F MST. After confirming all the tank and transducer values, if the error is less than 3%, you could adjust the -OS- value to reduce the difference.

TANK SHAPE: -11- Setting is for most vertical wall tanks, -00- setting for all other tank shapes, some shapes require custom programs that must be entered by the manufacturer and are not options available to be changed out in the field.

TANK CAPACITY: One of the most important required calibration points for this gauge is the actual capacity of the tank. If the value is not accurate (*the exact tank capacity*) the gauge will automatically begin with a "built in" percentage of *error*. If there is a manufacturer's tank chart available that is used with a stick, that is the capacity that should be used on the gauge setting for - *PP* - in the calibration process. *Any deviation from this will result in an inaccurate measurement of the liquid level in the tank.* Refer to the mathematic formulas in the trouble shooting section to compute the exact capacity of the tank.

The **LOW POINT** calibration value (- *LP* -) represents the number of gallons (or other measurable units) between the bottom of the hanging probe and the bottom of the tank. Even if the tank is completely empty the gauge should display this value. This value is equal to perhaps 2" to 5" of liquid depending on tank height. **LOW POINT** calibration adjustments are able to compensate for some minor inaccuracies in probe positioning and gauge readings.

The **HIGH POINT** calibration value (- *HP* -) is obtained from the published literature that was attached to the gauge when shipped. This value is **approximately** 75% of the tank capacity. Provided the density of the liquid in the tank is the same as the gauge was ordered for, *normally the HIGH POINT calibration value should never need to be changed.* The reason for this is that the high point is directly relational to the weight of the liquid being measured and not the level of the liquid. Changing this value without knowing what you are doing will make the gauge error in all the levels of the tank. Please contact Greenleaf Gauge for help at 888-884-2843 between 9:00-5:00 M-F MST. An example of when a gauge operating on a tank that has the liquid monitored is changed, i.e. gas to diesel (and that was the only change), this -*HP*- value would have to be changed. In some cases, the probe and/or the transducer would also need to be changed.

REMEMBER: The accuracy of this gauge depends on: the accuracy of the ordering information provided, accuracy of probe installation, and the accuracy of the information programmed into the gauge.

NOTE: During the calibration process, the gauge will automatically go to "normal" operating mode if too much time lapses between calibrating steps. If this occurs, go back into the calibration by starting at the top of the menu. Unnecessary steps can be passed through at any time simply by touching the PLANET symbol again and not changing the displayed values with the star or moon symbols.

CALIBRATION STEPS

NOTE: ☒ WILL BE DISPLAYED ON LEFT DIGIT OF DISPLAY DURING ENTIRE CALIBRATION PROCESS.

STEP 1: TANK SHAPE: Hold the end of the magnet on the PLANET ☾ symbol until the gauge displays ☒----. This indicates the beginning of the programming cycle. After removing the magnet, the display will read - 1 1 - for "straight" tanks, or - 0 0 - for "round" tanks. To switch the type of tank, hold the magnet to either the STAR ★ for "straight" style tanks (- 1 1 - will be displayed to signify a straight tank), or the MOON ☾ for "round" style tanks (- 0 0 - will be displayed to signify a round tank).

STEP 2: TANK CAPACITY: Hold the magnet to the PLANET and - P P - will appear. Remove the magnet and adjust the number shown to match the actual tank capacity. The correct tank capacity is critical to the accuracy of the gauge. Formulas for computing the tank capacity may be found in the troubleshooting section. To increase the numerical display, touch the magnet to the MOON, to decrease the numerical display, touch the magnet to the STAR. If you go past the desired value on the display, simply reverse the direction by using the other symbol. Continue in this manner until the desired value is displayed on the gauge.

STEP 3: LOW CALIBRATION LEVEL: Hold the magnet to the PLANET symbol and - L P - will appear. With vertical tanks this is a 1:1 adjustment. This value should represent the volume of fuel between the bottom of the tank and the bottom of the transducer. **EXAMPLE:** In vertical wall tanks this is calculated by the quantity of gallons per inch or some value of quantity per rise in height. Then do the math to calculate your quantity for your dimension. Horizontal cylindrical tanks are adjusted in the same manner, however the change is NOT a 1:1 ratio, get a tank chart made for the tank to make the correct input value. **DO NOT JUST SET THE LOW POINT TO THE CURRENT TANK VOLUME.** To adjust the LOW POINT, touch the magnet to the STAR or MOON symbols to enter the desired low calibration value. Use the STAR symbol to decrease the value, or the MOON symbol to increase the value. If your desired adjustment cannot be accomplished by changing the LOW POINT, call Greenleaf Gauge for technical assistance.

STEP 4: HIGH CALIBRATION LEVEL: Hold the magnet to the PLANET symbol and - H P - will appear. The high level calibration value sets the gauge for proper liquid densities. i.e. Different types of fuels. This value has been published on the gauge order form attached to the gauge when shipped. Once this value is set, there is no need to change it unless the density of the liquid in the tank is different than that for which the gauge was originally ordered. If it becomes necessary to change the high level, contact Greenleaf Gauge for technical assistance. **WARNING: If this value is changed incorrectly, the gauge will appear to operate, but will not track the volume correctly and an overfill event may result. Call for assistance.**

STEP 5: LOW LEVEL ALARM SETTING: Hold the magnet to the PLANET symbol and - R L - will appear. Remove the magnet and adjust the low level alarm value. Alarm values are displayed in % of tank capacity. To increase the %, hold the magnet to the MOON symbol, to decrease the %, hold the magnet to the STAR symbol. The low level can be set from 1% to 95%, we recommend a setting between 10-20%. The Low Level setting will not exceed the High Level setting. Turn off the low level alarm option by setting the value to 00.

STEP 6: HIGH LEVEL ALARM SETTING: Hold the magnet to the PLANET and - R H - will appear. Remove the magnet and adjust the high level alarm value. Alarm values are displayed in % of tank capacity. To increase the %, touch the magnet to the MOON symbol, to decrease the %, hold the magnet to the STAR symbol. The high level alarm can be set from 01% to 95 % of tank capacity but cannot be set at or lower than the low level alarm setting. Our recommendation is 90% or less.

STEP 7: is optional. Determine whether or not you want to use the OFF SET adjustment feature. This value can be entered as a **positive amount** which will add to the displayed amount, **OR** can be entered as a **negative amount** which will subtract from the displayed amount. Leaving the value of the off set at 00 will eliminate this option during normal operation. If you decide at a later date to activate this feature, simply go back through the menu and enter the off set value you wish. Touch the magnet to the PLANET symbol again and - 0 5 - will appear. To enter a negative off set value hold the magnet to the STAR symbol and a negative number will be shown. This value will automatically be **subtracted from** the displayed amount. To enter a positive off set value hold the magnet to the MOON symbol and a positive number will be shown. This value will automatically be **added to** the displayed amount.

STEP 8: Hold the magnet on the PLANET symbol until the gauge displays END- At this point the calibration process has been completed.

HELP: For technical help please contact us between 9-5 M-F MST: Local 208-453-1714, or toll free 888-88-GAUGE (888-884-2843). Our fax numbers are 208 459-3365, or 888-884-4145, or visit us online at www.solargauge.com.

TROUBLESHOOTING

Possible error messages that may be displayed on EFG-8000 model Solar Gauge.

- HELP** Gauge will alternate the *HELP* error message code with one of the following error messages to help identify the problem area to correct. DO NOT FILL TANK until the problem has been corrected and the gauge is operating properly.
- ***** Indicates a negative number. It may continue into the extended range until the gauge displays **-EE-**. For accuracy, the gauge should be re-calibrated. (*) Represents any numerical value, 0 through 9.
- EE-** Reading has gone below the extended range. Re-calibrate gauge to correct error.
- EEEE** Measurement has exceeded the set capacity of the tank. This could be due to an overflow, or the float is resting on the bottom of the tank from improper installation. Check measurements and/or re-calibrate.
- 0--0** Indicates a problem with the electrical connection between the transducer on top of the tank and the gauge. Check all wires and connections.
- LOBA** Low battery. Battery needs replaced. Contact distributor for authorized replacement.
- ISLA** Interstitial leak. (Optional model)

PRIOR TO CONTACTING GREENLEAF GAUGE FOR TECHNICAL SUPPORT, PLEASE VERIFY ORDER INFORMATION, GAUGE SETTINGS, AND COMPLETE THE FOLLOWING INFORMATION.

1. Gauge Serial # _____
2. Order # (if known) _____
3. **Accurate** measurement from bottom of tank to top of pipe nipple _____
4. **Actual** capacity of tank. Refer to formulas below. _____
5. Type of liquid in the tank _____
6. Current liquid level (inches or gallons) Please be accurate _____
8. Error messages displayed on gauge console _____
7. Changes or adjustments to original equipment _____
9. Other information _____

TO DETERMINE GALLONS PER TANK

Cylindrical tanks- measure in inches:

$$\text{Length X Diameter X Diameter X .0034} = \text{Gallons}$$

(Diameter = Circumference divided by 3.14)

Rectangular tanks- measure in inches:

$$\text{Length X Width X Depth X .004329} = \text{Gallons}$$

TECHNICAL ASSISTANCE

Greenleaf Gauge, Inc.
P. O. Box 309
Greenleaf, ID 83626
888-884-2843
208-453-1714
Fax 208-459-3365
E-mail: itm2@cableone.net
Web site: www.solargauge.com

SPECIFICATIONS MODEL EFG-8000

Supply Source.....	Solar Cell - 5Volt	
Backup power.....	Nickel Metal-Hydride Solar rechargeable battery - 9 Volt	
Accuracy.....	+ / - 1.0% optimal + / - 2.0% typical	
Housing.....	Plastic / Aluminum 6.0" H (9.0" W/ mounting Brackets) x 9.5"W x 1.5" D	mounting holes provided for 3" & 4" U-bolts. Holes: 5/16" & 7/16"
Indicators.....	6 digit LCD digital	
Operating Temperature.....	-30° F to +140° F	
Warranty.....	1 year	

IMPORTANT NOTICE: When gauge and alarm are utilized as the High-level warning, the test/reset button should **ALWAYS** be tested by the operator before tank filling. If it does not respond correctly **DO NOT FILL**. The operator must monitor the tank filling process and the status of the gauge and alarm to prevent overfills.

REPAIR AND RETURN POLICIES

REPAIRS

Your **SOLAR GAUGE™** display module (left side of console) has been hermetically sealed at the factory. Once the gauge has been installed on the tank with the float it was designed to work with, and calibrated properly, it should give years of flawless service. In the event you have a problem with this product, it needs to be returned to Greenleaf Gauge for repairs. Contact Greenleaf Gauge for warranty status and detailed instructions before returning the product. Gauges covered by warranty will be repaired/replaced at the option of Greenleaf Gauge. Please refer to the Terms and Conditions of warranty. If the gauge is past the warranty period, it may be returned for a core credit toward the purchase of a new gauge providing there are no signs of misuse, abuse, damage, or attempted repair.

RETURNS

To return your gauge for repairs contact Greenleaf Gauge for complete details concerning warranty issues as well as shipping requirements. Contact us between 9-5 M-F MST: Local 208-453-1714, or toll free 888-88-GAUGE (888-884-2843). Our fax numbers are 208 459-3365, or 888-884-4145, or visit us online at www.solargauge.com.

Shipping
Greenleaf Gauge
20675 N. Friends Rd.
Greenleaf, Idaho 83626

Mailing
Greenleaf Gauge
P. O. Box 309
Greenleaf, Idaho 83626-0309



Manufacturer's Suggested Annual Maintenance Protocol For

SOLAR GAUGE™

by Greenleaf Gauge
(Without test port)

The EFG-8000 series of liquid level gauges operate as a very simple gauging device with level alarm options that require almost no maintenance. Measuring the current liquid level in the tank and comparing the gauge reading to the charted amount can confirm normal gauge accuracy. The comparison between the gauge readout and the charted amount should differ no more than 2%, and typically operates with less than 1 % error.

The High and Low liquid level alarms are user set points in the gauge programming as a percent of the total tank capacity. Access to these alarm values may be reviewed by stepping through the setup program as detailed in the owners' manual*. The Low-level alarm may be set to "off" at a zero value or any value 5% under the High-level alarm value. The High-level alarm cannot be turned off and may not exceed 95% of tank capacity. We strongly recommend against setting the High-level alarm any higher than 90% in normal conditions.

Although this is not the preferred method, High Level alarms may be observed during filling as the liquid level reaches the set percentage of fill. The preferred method of a High level alarm activation, provided the tank level is above 50%, is to go into the setup program and adjust the High level alarm to just below the actual displayed level. This will trigger a High-level alarm. The last option is to temporarily unscrew the transducer** just up off the mounting nipple on top of the tank and very gently and slowly pull up on the beaded chain. This will simulate an actual High-level tank condition and activate the High-level alarm. Return the Transducer to the original position and secure all wire fittings.

*Owners' manuals are always available on the web at www.solargauge.com

**A EFG-TXD2- # (# is the size, i.e. A) transducer is available that provides a test port to pull on the probe without removing the transducer body from the tank nipple.

Sales Office
20675 N. Friends Road
P. O. Box 309
Greenleaf, ID 83626
USA



www.SOLAR GAUGE™.com
by

GREENLEAF
GAUGE



A Division of LTM Electronics, Inc.



888-884-2843
888-884-4145 - Fax
Outside USA
208-453-1714
208-459-3365 - Fax

Manufacturer's Suggested Annual Maintenance Protocol For The Interstitial Float Switch Assembly

The EFG-8000 series of liquid level gauges operates as a very simple gauging device with level alarm options, and an interstitial alarm option that requires almost no maintenance. This document is specifically about the interstitial float assembly operation and testing procedures.

The interstitial float device operates as a normally closed circuit device. An interstitial alarm will visually alternate in the LCD display by showing the letters "ISLA" and the gallons in the tank. This visual indicator will continue until the open circuit condition is cleared (the float returns to the bottom position). The Solar Gauge typically operates in a low power mode until it has sensed a greater than 2% tank volume change. When the gauge detects no liquid level change in the tank it goes into a power saving mode reducing the refresh timing of the display and alarm soundings. This is important to understand during testing of the interstitial float assembly and listening for the enunciation. Although the display will show the alarm in seconds, the enunciator may take up to approximately 90 seconds to enunciate the audible alarm - three short beeps. Once the alarm has sounded it will continue to enunciate approximately every 90 seconds until cleared.

Operational inspections must be done at least once a year depending on local inspector authority requirements. The preferred method of testing the assembly is removal from the interstitial cavity. (Note: pipe fittings must be provided above the interstitial cavity that allow for the inspection and removal of the interstitial assembly without disconnecting the communication wires.) Hold the assembly in your hand and inspect for liquid contamination past or present and document the findings. The preferred method of activation is by turning the assembly upside down. The float must fall freely and move to both extends when carefully shaken up and down. If the float does not move freely the assembly needs replaced. Next, holding the assembly upside down (wires coming out of assembly will be facing down), watch for the alarm message in the LCD display. You must hold this position until the three short beeps are heard. Another option is to temporarily place the assembly into a container of clean water, unleaded gas, or Av-Gas at least two inches deep (with the wires in an upright position). Test for the alarm under the timing conditions outlined above. **Diesel is not a recommended liquid to test in because it might show false contamination over years of testing.** With either method of testing, the float assembly should cause an interstitial alarm, which confirms correct operation of this device. When testing has correctly caused an alarm, carefully return the interstitial alarm assembly down into the bottom of the cavity and make sure all the pipe fittings are sealed against moisture. If you have questions on your results please contact customer assistance*.
888-884-2843 between 9-5 M-F, MST.

*Owners' manuals are always available on the web at www.solargauge.com

Sales Office
20675 N. Friends Road
P. O. Box 309
Greenleaf, ID 83626
USA



888-884-2843
888-884-4145 - Fax
Outside USA
208-453-1714
208-459-3365 - Fax

TERMS and CONDITIONS of PRODUCT APPLICATION and WARRANTY

WARRANTY. Greenleaf Gauge warrants solely to the first purchaser of new equipment in which a Greenleaf Gauge product has been installed by the original manufacturer of that equipment, or to the original purchaser of Greenleaf Gauge products for the purpose of installation on an existing tank, (referred to as Buyer), that its products shall be free from defects in materials and workmanship, when given normal, proper, and intended usage, for twelve (12) months from the date of sale to the Buyer. Greenleaf Gauge agrees to repair or replace at its option and without cost to Buyer all defective products sold, provided that Buyer has given Greenleaf Gauge notice of such warranty claim within such warranty period. * All products returned for repair or replacement must be sent freight prepaid to Greenleaf Gauge's plant, provided that Buyer first obtained from Greenleaf Gauge a Return Authorization Number (RAN) before any such return. Greenleaf Gauge shall have no obligation to make repairs or replacements which are required by normal wear and tear, or which result in whole or in part, from catastrophe, fault or negligence of Buyer, or from improper or unauthorized use of products, or use of the products in a manner for which they are not designed, or from unauthorized repair or alteration. No suit or action shall be brought against Greenleaf Gauge more than twelve (12) months after the related cause of action has accrued. Buyer has not relied and shall not rely on any oral representation regarding warranty of Greenleaf Gauge products, and any oral representation shall not bind Greenleaf Gauge and shall not be a part of any warranty.

THE PROVISIONS OF THE FOREGOING WARRANTY ARE IN LIEU OF ANY OTHER WARRANTY, WHETHER EXPRESSED OR IMPLIED, WRITTEN OR ORAL (INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE). GREENLEAF GAUGE'S LIABILITY ARISING OUT OF THE MANUFACTURE, SALE OR SUPPLYING OF THEIR PRODUCTS OR THEIR USE OR DISPOSITION, WHETHER BASED UPON WARRANTY, CONTRACT, TORT OR OTHERWISE SHALL NOT EXCEED THE ACTUAL PURCHASE PRICE PAID BY THE BUYER FOR THE PRODUCTS. IN NO EVENT SHALL GREENLEAF GAUGE, INC. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES, INCLUDING, BUT NOT LIMITED TO, LOSS OF PROFITS, OR LOSS OF USE DAMAGES ARISING OUT OF THE MANUFACTURE, SALE, OR SUPPLYING OF THE GREENLEAF GAUGE PRODUCTS. THIS WARRANTY MAY NOT BE TRANSFERRED TO ANY OTHER PERSON OR ENTITY.

Some states do not permit limitation or exclusion of implied warranties; therefore, the aforesaid limitation(s) or exclusion(s) may not apply to the purchaser. This warranty gives you specific legal rights and you may also have other rights which vary from state to state.

*For service instructions call Greenleaf Gauge at 208-453-1714 or toll free 888-884-2843.

We Service What We Sell

©2003 Greenleaf Gauge

